





Randomisation

- 1 Check availability of CPAP and/or HFNO device prior to randomisation (any brand of device can be used)

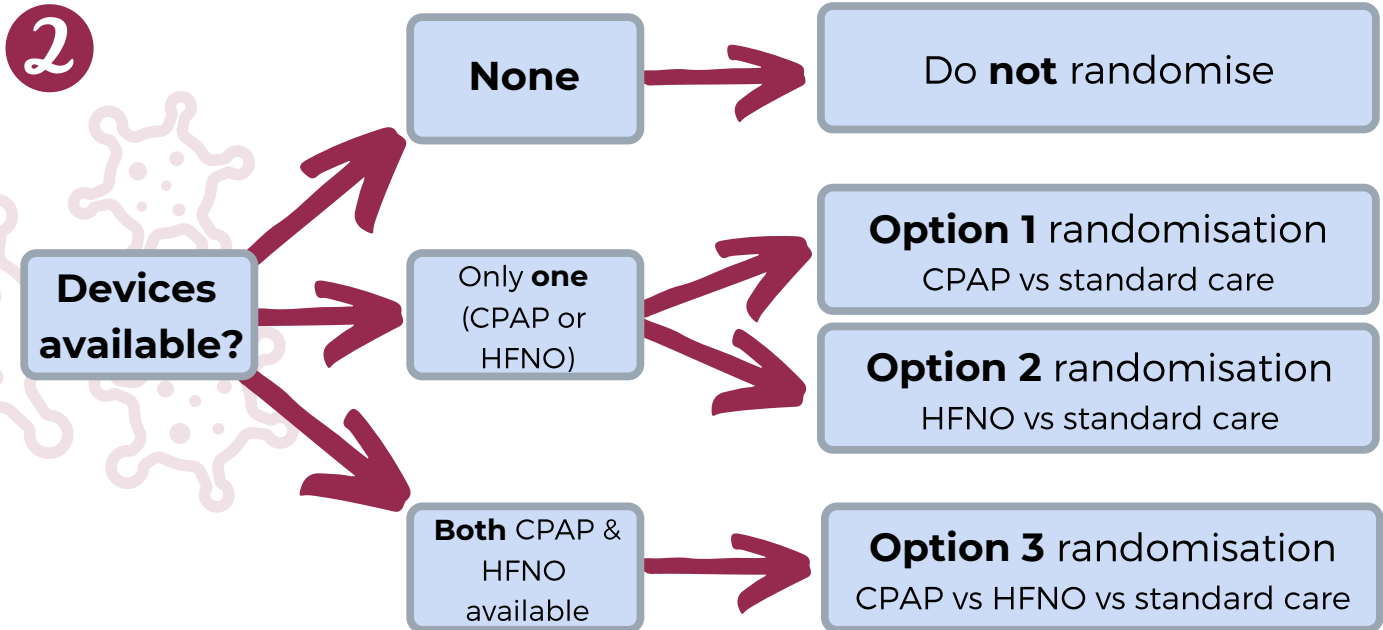

- 3  **Complete** paper randomisation form

- 4  **Randomise** 
Using Interactive Voice Response (IVR) system
Call: 02476 109940

- 5  **Enter** details from randomisation form onto RECOVERY-RS database.
File paper form in Site file