



PRT
HEATING LTD
COMMERCIAL | INDUSTRIAL | DOMESTIC

[illegible]

Gas Tightness Test									
Gas tightness test carried out (Yes / No)	Yes	Total Installation volume (m³)	0.0019	Max allowable pressure drop (mbar)	4	Type of gauge used (water / electronic)	Electric	Tightness test result (Pass / Fail)	
Where was the Test carried out from?	ECV	Let by test duration (mins)	1	Volume smallest occupied space (m³)	N/A	Smell of gas	N/A	Pass	
Scope of work (e.g. IGE/UP/1 or 1A or 1B)	IGE/UP/1B	Stabilisation period (mins)	1	Tightness test pressure (TTP) (mbar)	21.01	CO Alarm			
						CO Alarm Installed	Date Of Expiry	CO Pass/Fail	
Installation (New / Existing / Extension)	Existing	Tightness test duration (mins)	2	Actual pressure drop (mbar)	0	Yes	07/2035	Pass	
Meter Information									
Gas Meter Present	Yes	Meter room secure	N/A	Meter room key labelled	N/A	Standing pressure (mbar)		Working pressure at Appliances (mbar)	
Meter size	U6	Meter accessible	Yes	Meter room ventilated	N/A	Working pressure at meter	N/A	18.95	
ECV labelled	Yes	Does ECV operate easily	Yes	Adequate gas isolation	Yes	Suitably sleeved Area Adjacent Meter	Yes	Meter Labelling Correct	
Pipework colour coded /identified from point of Test	Yes	Line diagram at meter (current)	N/A	Clear of combustibles	Yes	Installation cross bonded	Yes	Yes	
Gas pipe supported (Where Visible) from point of Test	Yes	Meter Location	Yes		Flue Dilution (CO₂) %	N/A	Air Sample (CO₂) %	N/A	
Manometer Make	Testo	Serial No	26884240		Analyser Make	Testo	Serial No	61857248	
Description of work: Boiler service and co2 device check									
Defects					Remedial work required				
No 1									
No 2									
No 3									
No 4									
No 5									
No 6									
No 7									
No 8									
Parts used			Part Number		Qty		Declaration of Gas safety: I confirm that all of the work described on this form has been satisfactorily completed in accordance with the current Gas Safety (Installation & Use) regulations, industry standards and procedures.		
Print Name	Jack Williams		Engineer's Signature						
The work has been carried out to my satisfaction. I agree to pay for all chargeable work carried out and the cost of any parts ordered and/or supplied.									
Print Name	No person present		Customer Signature						

Tightness Test Carried out from this Valve 'Label'

General information

Customer	Name of measurement program	Tightness test
54 heronbank	Date of measurement	21/05/2026 9:43:48

Instrument information

Instrument name/Serial number	Measurement parameters
testo 510 (46884240)	Differential pressure


Measurement parameters

Measuring mode	Timed	Maximum pressure drop	0.25 mbar
Measuring cycle	20 sec	Pressure start (P-Start)	21.01 mbar
Use stabilisation time	Yes	Measurement result	Passed
Measurement duration (target)	2 min 0 sec	Start time	21/05/2026 9:41:31
Pressure probe	testo 510 (46884240)	End	21/05/2026 9:43:31
Fuel type	Propane	Duration	2 min 0 sec

Measurement

Maximum pressure drop	0.25 mbar
Final pressure drop	0.23 mbar

Date/Time	ΔP [mbar]	ΔP current [mbar]
21/05/2026 9:41:31	21.01	0.00
21/05/2026 9:41:51	21.01	0.00
21/05/2026 9:42:11	21.08	0.07
21/05/2026 9:42:31	21.17	0.16
21/05/2026 9:42:51	21.20	0.19
21/05/2026 9:43:11	21.22	0.21
21/05/2026 9:43:31	21.24	0.23

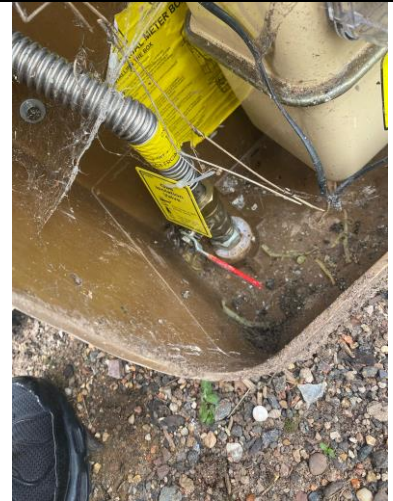

Appliance Flue Termination



Warning Label 'if Applicable'

CO Expiry Date

Location of CO Alarm



Photo of Unsafe Situation	Defect 1	Defect 2
Defect 3	Defect 4	Defect 5
Defect 6	Defect 7	Defect 8