




Gas Tightness Test									
Gas tightness test carried out (Yes / No)	Yes	Total Installation volume (m <sup>3</sup> )	0.0032	Max allowable pressure drop (mbar)	4	Type of gauge used (water / electronic)	Electric	Tightness test result (Pass / Fail)	
Where was the Test carried out from?	ECV	Let by test duration (mins)	1	Volume smallest occupied space (m <sup>3</sup> )	N/A	Smell of gas	N/A	Pass	
Scope of work (e.g. IGE/UP/1 or 1A or 1B)	IGE/UP/1B	Stabilisation period (mins)	1	Tightness test pressure (TTP) (mbar)	20.50	CO Alarm			
						CO Alarm Installed	Date Of Expiry	CO Pass/Fail	
Installation (New / Existing / Extension)	Existing	Tightness test duration (mins)	2	Actual pressure drop (mbar)	0	Yes	08/2034	Pass	
Meter Information									
Gas Meter Present	Yes	Meter room secure	N/A	Meter room key labelled	N/A	Standing pressure (mbar)		Working pressure at Appliances (mbar)	
Meter size	U6	Meter accessible	Yes	Meter room ventilated	N/A	Working pressure at meter	21.78	20.38	
ECV labelled	Yes	Does ECV operate easily	Yes	Adequate gas isolation	Yes	Suitably sleeved Area Adjacent Meter	Yes	Meter Labelling Correct	
Pipework colour coded /identified from point of Test	Yes	Line diagram at meter (current)	N/A	Clear of combustibles	Yes	Installation cross bonded	Yes	Yes	
Gas pipe supported (Where Visible) from point of Test	Yes	Meter Location	Outside meter box		Flue Dilution (CO <sub>2</sub> ) %	N/A	Air Sample (CO <sub>2</sub> ) %	N/A	
Manometer Make	Testo	Serial No	26884240	Analyser Make	Testo	Serial No	61857248		
Description of work: Boiler service, co device check and cp12									
Defects					Remedial work required				
No 1									
No 2									
No 3									
No 4									
No 5									
No 6									
No 7									
No 8									
Parts used			Part Number		Qty		Declaration of Gas safety: I confirm that all of the work described on this form has been satisfactorily completed in accordance with the current Gas Safety (Installation & Use) regulations, industry standards and procedures.		
Print Name	Jack Williams		Engineer's Signature						
The work has been carried out to my satisfaction. I agree to pay for all chargeable work carried out and the cost of any parts ordered and/or supplied.									
Print Name	No person present		Customer Signature						

## Tightness Test Carried out from this Valve 'Label'



### Measurement protocol

**General information**

<b>Customer</b>	<b>Name of measurement program</b>	<b>Tightness test</b>
61 Heronbank		
	<b>Date of measurement</b>	04/12/2025 10:32:40

**Instrument information**

<b>Instrument name/Serial number</b>	<b>Measurement parameters</b>
testo 510 (46884240)	Differential pressure

**Measurement parameters**


<b>Measuring mode</b>	Timed	<b>Maximum pressure drop</b>	4.00 mbar
<b>Measuring cycle</b>	20 sec	<b>Pressure start (P Start)</b>	20.50 mbar
<b>Use stabilisation time</b>	Yes	<b>Measurement result</b>	Passed
<b>Measurement duration (target)</b>	2 min 0 sec	<b>Start time</b>	04/12/2025 10:29:36
<b>Pressure probe</b>	testo 510 (46884240)	<b>End</b>	04/12/2025 10:31:36
<b>Fuel type</b>	Natural gas	<b>Duration</b>	2 min 0 sec

**Measurement**

<b>Maximum pressure drop</b>	4.00 mbar
<b>Final pressure drop</b>	0.05 mbar

Date/Time	ΔP [mbar]	ΔP current [mbar]
04/12/2025 10:29:36	20.50	
04/12/2025 10:29:56	20.52	0.02
04/12/2025 10:30:16	20.52	0.02
04/12/2025 10:30:36	20.54	0.04
04/12/2025 10:30:56	20.57	0.07
04/12/2025 10:31:16	20.53	0.03
04/12/2025 10:31:36	20.55	0.05

## Appliance Flue Termination

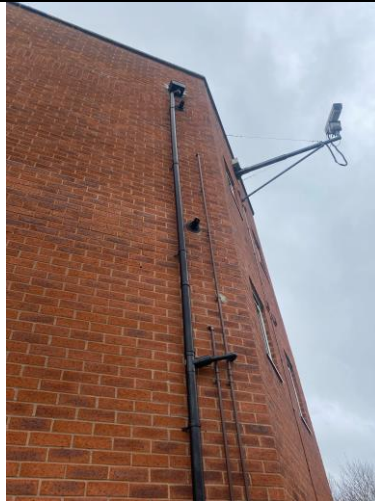

Warning Label 'if Applicable'

CO Expiry Date

Location of CO Alarm



Photo of Unsafe Situation	Defect 1	Defect 2
Defect 3	Defect 4	Defect 5
Defect 6	Defect 7	Defect 8