


| Gas Tightness Test | | | | | | | | | |
|---|-------------------|---|----------------------|--|---|---|---|---------------------------------------|--|
| Gas tightness test carried out (Yes / No) | Yes | Total Installation volume (m ³) | | Max allowable pressure drop (mbar) | 4 | Type of gauge used (water / electronic) | Electric | Tightness test result (Pass / Fail) | |
| Where was the Test carried out from? | ECV | Let by test duration (mins) | 1 | Volume smallest occupied space (m ³) | | Smell of gas | N/A | Pass | |
| Scope of work (e.g. IGE/UP/1 or 1A or 1B) | IGE/UP/1B | Stabilisation period (mins) | 1 | Tightness test pressure (TTP) (mbar) | 18.57 | CO Alarm | | | |
| | | | | | | CO Alarm Installed | Date Of Expiry | CO Pass/Fail | |
| Installation (New / Existing / Extension) | Existing | Tightness test duration (mins) | 2 | Actual pressure drop (mbar) | 0.39 | Yes | 07/2033 | Pass | |
| Meter Information | | | | | | | | | |
| Gas Meter Present | Yes | Meter room secure | N/A | Meter room key labelled | N/A | Standing pressure (mbar) | | Working pressure at Appliances (mbar) | |
| Meter size | U6 | Meter accessible | Yes | Meter room ventilated | N/A | Working pressure at meter | 20.76 | 18.28 | |
| ECV labelled | Yes | Does ECV operate easily | Yes | Adequate gas isolation | Yes | Suitably sleeved Area Adjacent Meter | Yes | Meter Labelling Correct | |
| Pipework colour coded /identified from point of Test | Yes | Line diagram at meter (current) | Yes | Clear of combustibles | N/A | Installation cross bonded | Yes | Yes | |
| Gas pipe supported (Where Visible) from point of Test | Yes | Meter Location | Outside meter box | | Flue Dilution (CO ₂) % | N/A | Air Sample (CO ₂) % | N/A | |
| Manometer Make | Testo | Serial No | 26884240 | | Analyser Make | Testo | Serial No | 61857248 | |
| Description of work: Boiler service and co device check. Boiler is great condition for its age. | | | | | | | | | |
| Defects | | | | | Remedial work required | | | | |
| No 1 | | | | | | | | | |
| No 2 | | | | | | | | | |
| No 3 | | | | | | | | | |
| No 4 | | | | | | | | | |
| No 5 | | | | | | | | | |
| No 6 | | | | | | | | | |
| No 7 | | | | | | | | | |
| No 8 | | | | | | | | | |
| Parts used | | | Part Number | | Qty | | Declaration of Gas safety: I confirm that all of the work described on this form has been satisfactorily completed in accordance with the current Gas Safety (Installation & Use) regulations, industry standards and procedures. | | |
| | | | | | | | | | |
| | | | | | | | | | |
| Print Name | Jack Williams | | Engineer's Signature | |  | | | | |
| The work has been carried out to my satisfaction. I agree to pay for all chargeable work carried out and the cost of any parts ordered and/or supplied. | | | | | | | | | |
| Print Name | No person present | | Customer Signature | | | | | | |

Tightness Test Carried out from this Valve 'Label'



Measurement protocol

General information

| | | | |
|-------------------------------|------------------------|-----------------------------|---------------------|
| Customer | 46 Lakeside Staff Flat | Name of measurement program | Tightness test |
| Instrument name/Serial number | Instid 6101 (46884240) | Date of measurement | 04/06/2025 13:27:43 |

Instrument information

| | | |
|-------------------------------|------------------------|------------------------|
| Instrument name/Serial number | Instid 6101 (46884240) | Measurement parameters |
| Instid 6101 (46884240) | Differential pressure | |

Measurement parameters

| | | | |
|-----------------------|------------------------|--------------------------|---------------------|
| Measuring media | Timed | Maximum pressure drop | 4.10 mbar |
| Measuring cycle | 30 sec | Pressure start (P Start) | 18.27 mbar |
| Line calibration time | Yes | Measurement event | Passport |
| Measurement duration | 2 min 0 sec | Start time | 04/06/2025 13:25:39 |
| Pressure probe | Instid 6101 (46884240) | Stop | 04/06/2025 13:27:39 |
| Fuel type | Natural gas | Duration | 2 min 0 sec |

Summary

| | |
|-----------------------|------------|
| Maximum pressure drop | 4.10 mbar |
| Final pressure drop | -0.39 mbar |


| Date/Time | ΔP0 (mbar) | ΔP current (mbar) |
|---------------------|------------|-------------------|
| 04/06/2025 13:25:39 | 18.27 | -0.39 |
| 04/06/2025 13:26:09 | 18.44 | -0.38 |
| 04/06/2025 13:26:19 | 18.38 | -0.37 |
| 04/06/2025 13:26:29 | 18.26 | -0.37 |
| 04/06/2025 13:26:39 | 18.21 | -0.36 |
| 04/06/2025 13:27:13 | 18.18 | -0.36 |
| 04/06/2025 13:27:39 | 18.18 | -0.39 |

Appliance Flue Termination

Warning Label 'if Applicable'

CO Expiry Date

Location of CO Alarm

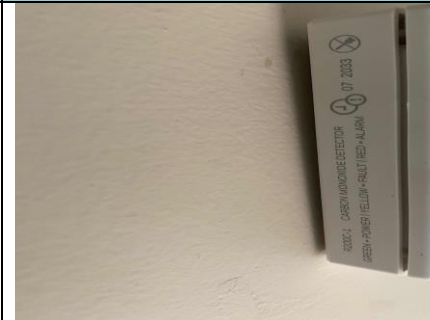

| Photo of Unsafe Situation | Defect 1 | Defect 2 |
|---------------------------|----------|----------|
| | | |
| Defect 3 | Defect 4 | Defect 5 |
| | | |
| Defect 6 | Defect 7 | Defect 8 |
| | | |